



Replace Existing Curb & Gutter As Needed To Achieve 6' Minimum Opening At Curb Line

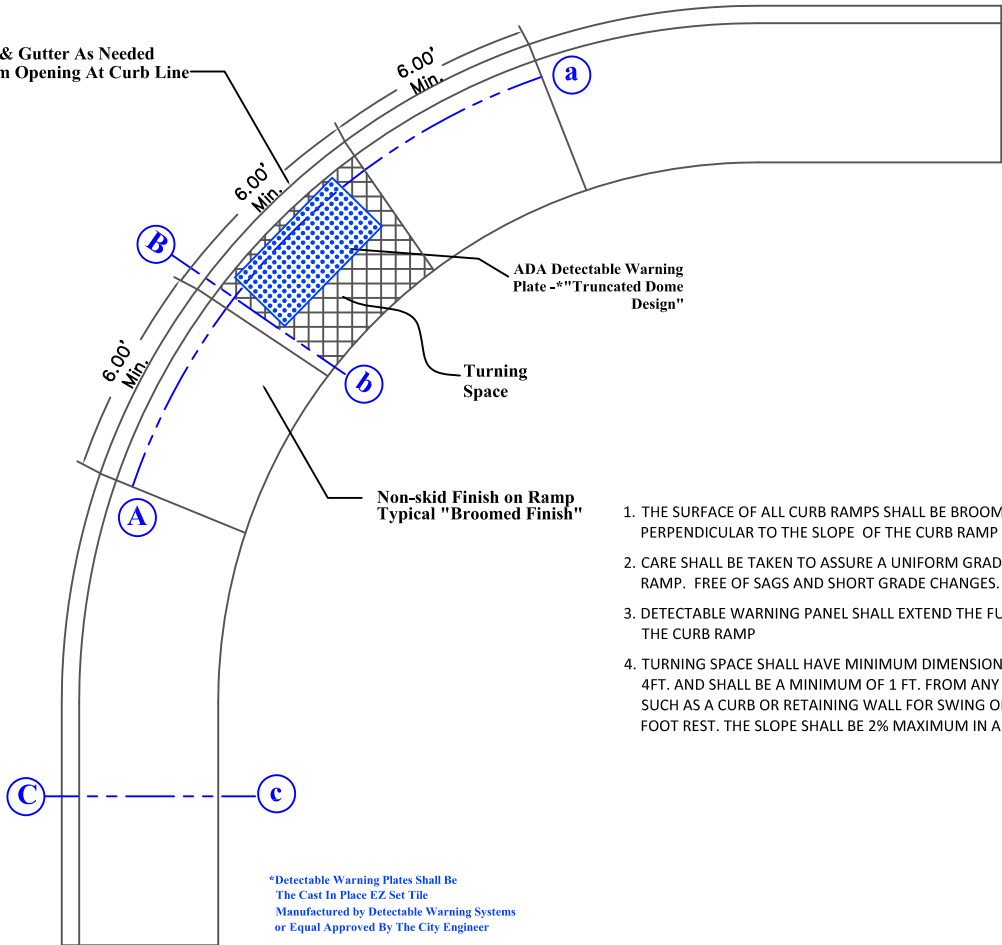

1. THE SURFACE OF ALL CURB RAMPS SHALL BE BROOMED PERPENDICULAR TO THE SLOPE OF THE CURB RAMP
2. CARE SHALL BE TAKEN TO ASSURE A UNIFORM GRADE ON THE RAMP. FREE OF SAGS AND SHORT GRADE CHANGES.
3. DETECTABLE WARNING PANEL SHALL EXTEND THE FULL WIDTH OF THE CURB RAMP
4. TURNING SPACE SHALL HAVE MINIMUM DIMENSIONS OF 4 FT. x 4FT. AND SHALL BE A MINIMUM OF 1 FT. FROM ANY OBSTACLE SUCH AS A CURB OR RETAINING WALL FOR SWING OF WHEELCHAIR FOOT REST. THE SLOPE SHALL BE 2% MAXIMUM IN ANY DIRECTION.

Typical Curb Ramp Section

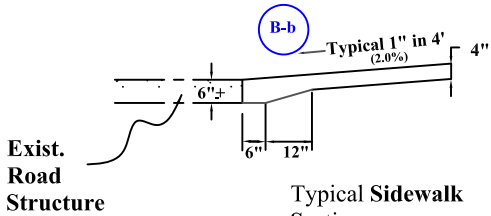

Typical Sidewalk Section

